

VESDA

RAILS



PROTECTING RAIL PASSENGERS AND INFRASTRUCTURE FROM FIRE

- ENSURE SAFE EVACUATIONS BY INCREASING THE AVAILABLE TIME
- AVOID MAJOR ASSET LOSS
- REDUCE FALSE ALARMS
- LOWER MAINTENANCE COSTS
- YIELD IMPROVED SERVICE CONTINUITY AND EFFICIENCY

In 2006, a subway fire started in stored wood ties (wooden sleepers for rail tracks) in Brooklyn, NY, requiring 4000 passengers to be evacuated, injuring at least 25 people, and causing delays to thousands of peak hour commuters.

The consequences of smoke or fire in a crowded rail facility are dangerous and possibly fatal. The feeling of panic spreads quickly and hampers any chance of a safe and orderly evacuation.

Exit from a railway station is often along the same path as smoke will travel. Escalators and stairways act like chimneys for smoke – and smoke kills!

Trying to evacuate a train is difficult and dangerous. Even evacuation does not guarantee escape from the smoke trapped in a tunnel or an underground station.

Service interruption can impact thousands of commuters, and service level obligations and profitability will be threatened.

WHAT ARE THE RISKS?

Fires in rail facilities result from:

- High current electrical faults.
- Friction caused by mechanical faults, fueled by a build-up of oil, dirt and lint.
- Arson, which commonly occurs in unsupervised areas, and may be started using discarded litter.
- Unauthorized cigarette smoking.

WHAT MAKES A FIRE SPREAD?

In rail facilities, the growth and spread of fire is fueled by:

- Dirt and lint, which builds up on the moving parts of mechanical equipment and acts like a wick.
- High airflow, resulting from Heating Ventilation and Air Conditioning (HVAC) systems and the motion of trains.
- Litter, in the form of newspapers and other rubbish.


DETECTION CHALLENGES

- Air movement from drafts, air-conditioning and train motion interferes with the normal dispersion of smoke; often drawing it away from conventional detectors.
- Smoke from small or smouldering fires lacks sufficient thermal energy to rise to conventional detectors located on the high ceilings of atriums and concourses.
- Within escalators and other concealed mechanical equipment, fires tend to smoulder for a long time. This delays detection by conventional detectors.

HOW CAN YOU PROTECT LIVES AND RAIL SERVICES?

A specialized design approach and the early detection of smoke will save lives, maintain business continuity and protect assets.

In 2003, over 100 people were killed by a fire that started in an underground station in South Korea.

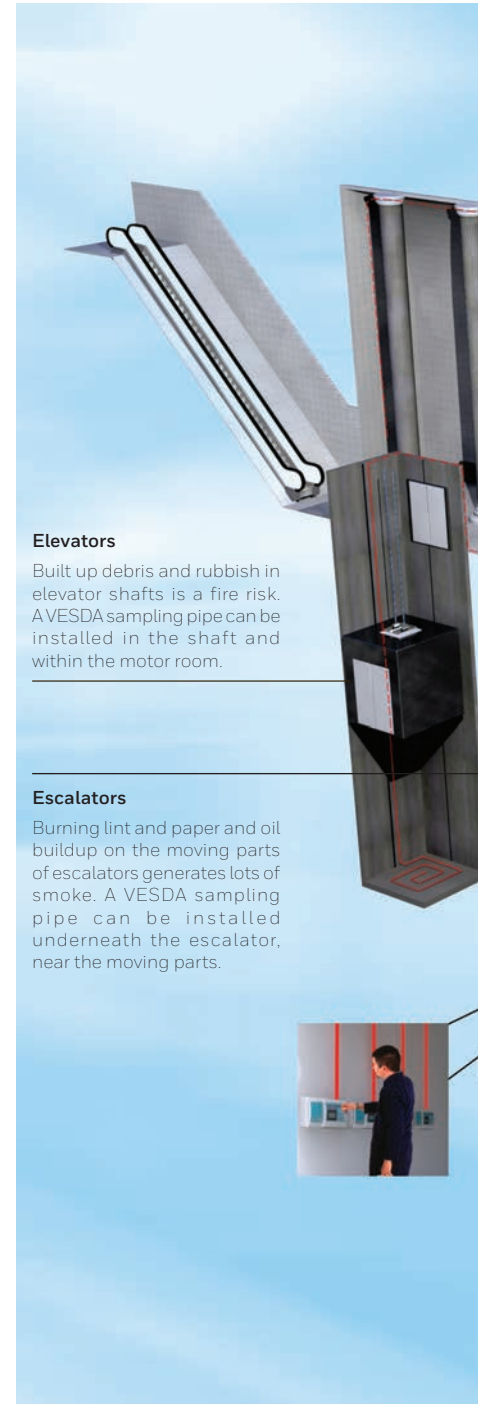

Atriums and Concourses

Smoke dilutes and stratifies below high ceilings, never reaching the conventional detectors above. VESDA sampling pipes can be located where smoke is likely to spread, ensuring early detection.

Emergency Control Rooms

Positioning a VESDA sampling pipe across the return air vent of an air conditioning unit detects smoke as it is carried with the airflow. Sampling on the ceiling can be used for actuation of suppression systems.

Emergency Control Rooms

By installing VESDA sampling pipes inside equipment cabinets and in the sub-floor space, any smoke is quickly drawn to a detector.

Substations

High voltage cables, switch gear and uninterrupted power supply batteries are a fire risk. A VESDA solution provides targeted equipment protection, allowing early warning of a fire, and time to plan.

Air Handling and Exhaust Systems

Air handling systems can purge smoke and buy time for evacuation. A VESDA sampling pipe can be positioned across the exhaust fan vent. VESDA detectors can also be used for air quality management and energy consumption reduction.

Service Cupboards


High current electrical equipment and densely packed cables are a fire hazard. VESDA sampling pipes can be installed in cable trays and within equipment cabinets.

Trains

High voltage electrical systems and the fuel loads brought aboard (e.g. newspapers) increase the risk of fire. High airflow within and around the train makes the detection of smoke difficult. VESDA can detect invisible, incipient smoke.

Service Ducts and Tunnels

Dusty service ducts and tunnels can be protected with VESDA detectors – without false alarms or excessive maintenance costs.

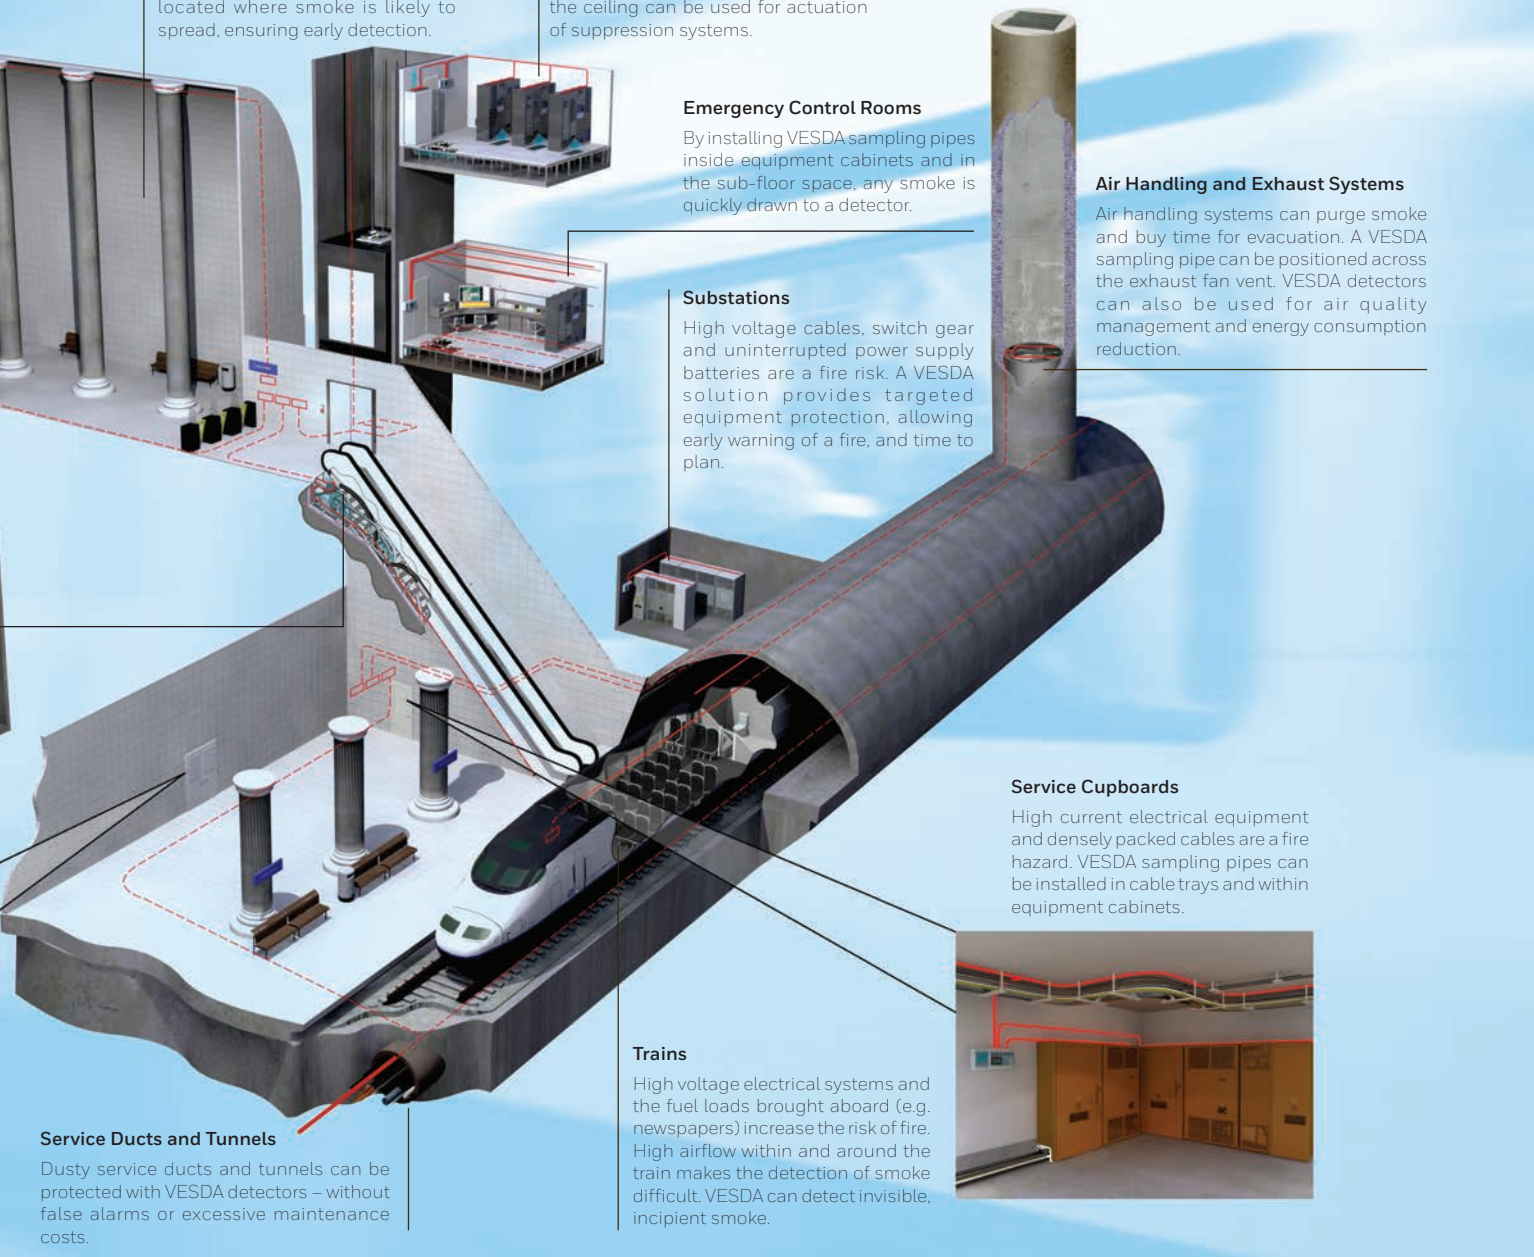

31 people died in the tragic 1987 escalator fire in Kings Cross, London, when the presence of smoke caused panic.

THE VESDA SOLUTION

A VESDA aspirating smoke detector works by continually drawing air into a series of pipes attached to a detector unit. Air is moved through a laser detection chamber where it is analyzed for smoke. The detector can be positioned in an area that allows easy access for maintenance.

VESDA detectors can be connected to a standard fire alarm control panel, a building management system or a software-based monitoring system. They are ideally suited to the diverse environments found in a rail facility. The key advantage they offer is detecting smoke at the earliest stages of a fire.

This allows:

- Investigation of what caused the alarm.
- Preventative action to stop the spread of fire or toxic smoke.
- Safe and orderly evacuation.
- Prevention of damage to expensive and vital equipment.
- The avoidance of service disruption and breaches of service level obligations.

RAIL FACILITIES AND FLEETS THAT HAVE A VESDA SYSTEM INSTALLED

London Underground
Moscow Metro
Hong Kong KCRC
Shanghai South Station

Madrid Metro
Queensland Tilt Train
Perth Urban Rail
XPT High Speed Express

China Star Express
RailCorp Hunter DMU
City Rail Explorer

GLOBAL APPROVALS



ABOUT XTRALIS



Xtralis is a leading global provider of powerful solutions for very early & reliable detection of smoke, fire, and gas threats. Our technologies prevent disasters by giving users time to respond before life, critical infrastructure or business continuity is compromised.

We protect highly valuable and irreplaceable assets and infrastructure belonging to the world's top governments and businesses.

To learn more, please visit us at www.xtralis.com