

CHEMICAL FILTER FOR CORROSIVE ENVIRONMENTS APPLICATION NOTE

Preface

Xtralis recommends the use of chemical filters when chemical adsorption / absorption is required to remove corrosive gases from the sampled airstream prior entering VESDA units.

This Application Note is intended as a guide for the market to improve the product life, safety and performance of a VESDA system that has been selected for use in a hazardous environment. Though the manufacturer's product warranty may be voided by the use of the detector in such corrosive gaseous environments, it is understood that this commercial risk may be deemed acceptable by the market in some applications. Following the recommendations of this Application Note MAY NOT avoid all risks of the product warranty being voided.

Related Products

Chemical filters can be used with all VESDA detectors except VEA.

Contents

1	Introduction.....	1
2	Chemical Filter Assembly.....	2
	2.1 Chemical Filter Impedance / Smoke Transmission	3
3	Chemical Filter Installation.....	5
4	Chemical Filter Commissioning and Maintenance	5
5	Chemical Media Disposal	5
6	Further Support	5
	Disclaimer On The Provision Of General System Design Recommendations.....	6

1 Introduction

Corrosive gases have the potential to impact operation and affect the life of VESDA detectors. Corrosion effects include thermal failures, short circuit, metal loss, and are usually accelerated by heat and moisture.

Sources of corrosive gases can be combustion processes, bleaching operations, cleaning compounds, etc. and include acidic gases (H₂S, NO_x, Cl₂), caustic gases (NH₃), oxidizing gases (O₃).

**Note!**

A VESDA detector protecting a corrosive environment and installed outside the protected area is still vulnerable since corrosive gases will be aspirated to the detector via the pipe network.

To protect VESDA detectors against corrosion, the sampled airstream must be “purified” by passing it through a “bed” of chemical media (beads) before it enters the detector.

For effective removal of corrosive gases from the detector airstream, the correct type and quantity of chemical media specific to the type and concentration of gas(es) of concern must be used. Chemical media manufacturers¹ can assist to identify the type and quantity of chemical media by taking into consideration the VESDA pipe network parameters (airstream flowrate / temperature / humidity).

**Note!**

- When more than one corrosive gas is present, a combination of chemical media should be used for each target gas.
- Pipe network components must be chemically resistant against the target gas.
- When detector is mounted outside the protected area, ensure the exhaust air is returned to the protected area.

¹ For example, Purafil (<http://www.purafil.com>)

2 Chemical Filter Assembly

Different chemical filter assemblies can be used with VESDA systems provided (i) flow impedance and (ii) smoke transmission properties are quantified and accounted for in the ASPIRE design. For information on this assessment refer to the *Xtralis Open-flow In-Line Components Application Note (No. 18336)*.

An example of a chemical filter is shown in Figure 1 assembled from commercially available parts (Table 1) comprising (i) 10" standard filter housing, (ii) refillable cartridge.



(i) 10" Standard Filter Housing



(ii) Refillable Cartridge for 10" Standard Filter Housing

Figure 1: Chemical Filter Assembly

Table 1: Chemical Filter Assembly Parts

Part	Brand	Model	Suggested Source
Pentek 150072 10" Standard Filter Housing Blue/Clear w/o PR - 3/4" FPT	Pentek	150072	https://www.freshwatersystems.com/
Clear Pentek 10" 3/4" BSP Housing 150096	Pentek	150096	https://www.clarencewaterfilters.com.au
Empty, Refillable Water Filter Cartridge Universal (2.5" x 10") Clear Filter	Oceanic Water Systems	EC2510	https://oceanicwater.com



Note!

Select a clear 10" Standard Filter Housing sump to allow for visual inspection of changing chemical media colour.

The refillable cartridge will require a 3-step modification process to accommodate the chemical media as shown in Figure 2.



Refillable Cartridge
(Original State)

- Step 1: Remove white cap
- Step 2: Remove PU foam

Refillable Cartridge
(Modified)

Figure 2: Refillable Cartridge Modification

Once modified, the refillable cartridge is inserted in the 10" filter housing and loaded with chemical media.



Note!

Ensure refillable cartridge is inserted vertically in the filter housing and cap is firmly tighten.

2.1 Chemical Filter Impedance / Smoke Transmission

The inclusion of a chemical filter on the VESDA sampling pipe will affect impedance and smoke transmission which needs to be quantified and accounted for in the ASPIRE design. Detailed information to undertake this assessment is available in the *Xtralis Open-flow In-Line Components Application Note (No. 18336)*.

An example of this assessment is shown below for the chemical filter described in the previous section. The assessment applies to activated carbon chemical media (brand: COL-RPA50, beads: Ø3mm / 4mm length, volume: 400ml i.e. half loaded refillable cartridge, supplier: Carbon Activated Corp., AU).

Accounting for impedance in ASPIRE:

1. Obtain chemical filter pressure/flow relationship (Figure 3).

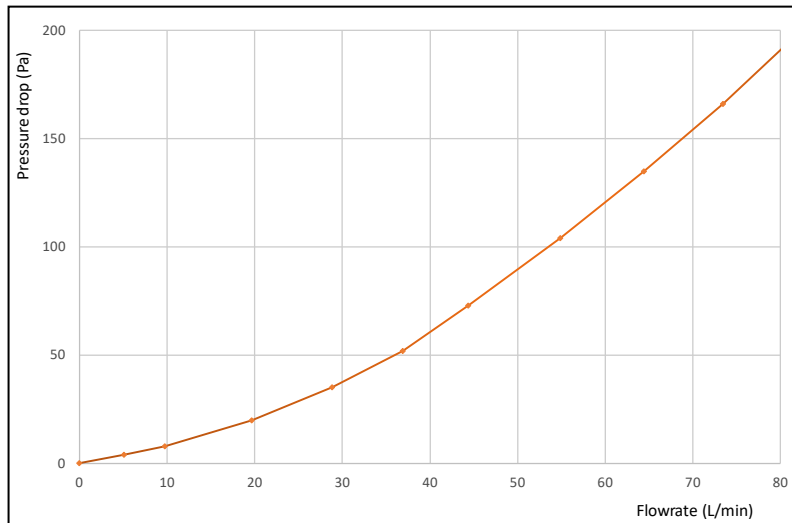


Figure 3: Chemical Filter Impedance Curve

2. Create the initial ASPIRE design (Figure 4). Note the Pipe Flowrate for pipe section where chemical filter is intended to be installed i.e. 27.0L/min.

Item	Type	Absolute Distance	Relative Distance	Hole Diameter	Tube Length	Transport Time	Pressure	Flow	Flow%	Hole Sensitivity	Pipe Diameter	Tube Diameter	Direction	Intersection Pressure
	Bend 90	2.67	2.67										L	
	Bend 90	5.34	2.67										F	
1:Section0-1	Hole	8.00	2.66	2.5		8	135	3.6	13.5	1.483	21.0			
1:Section0-2	Hole	13.00	5.00	2.5		11	126	3.5	13.0	1.536	21.0			
1:Section0-3	Hole	18.00	5.00	2.5		15	118	3.4	12.6	1.582	21.0			
1:Section0-4	Hole	23.00	5.00	2.5		19	113	3.3	12.3	1.620	21.0			
1:Section0-5	Hole	28.00	5.00	2.5		25	109	3.3	12.1	1.650	21.0			
1:Section0-6	Hole	33.00	5.00	2.5		32	106	3.2	11.9	1.674	21.0			
1:Section0-7	Hole	38.00	5.00	2.5		43	104	3.2	11.8	1.691	21.0			
1:Section0-8	Endcap	43.00	5.00	2.5		65	103	3.4	12.6	1.588	21.0			

Figure 4: ASPIRE – Initial Design

3. From Figure 3, note the pressure value corresponding to 27.0L/min flowrate, i.e. 40Pa.
4. In the initial ASPIRE design, insert the negative value of this pressure (-40Pa) in Ambient Pressure and re-calculate (Figure 5).

Item	Type	Absolute Distance	Relative Distance	Hole Diameter	Tube Length	Transport Time	Pressure	Flow	Flow%	Hole Sensitivity	Pipe Diameter	Tube Diameter	Direction	Intersection Pressure
	Bend 90	2.67	2.67										L	
	Bend 90	5.34	2.67										F	
1:Section0-1	Hole	8.00	2.66	2.5		9	99	3.1	13.6	1.470	21.0			
1:Section0-2	Hole	13.00	5.00	2.5		13	92	3.0	13.1	1.527	21.0			
1:Section0-3	Hole	18.00	5.00	2.5		17	87	2.9	12.7	1.576	21.0			
1:Section0-4	Hole	23.00	5.00	2.5		22	82	2.8	12.4	1.618	21.0			
1:Section0-5	Hole	28.00	5.00	2.5		29	79	2.8	12.1	1.653	21.0			
1:Section0-6	Hole	33.00	5.00	2.5		36	76	2.7	11.9	1.682	21.0			
1:Section0-7	Hole	38.00	5.00	2.5		51	74	2.7	11.8	1.701	21.0			
1:Section0-8	Endcap	43.00	5.00	2.5		76	73	2.9	12.5	1.600	21.0			

Figure 5: ASPIRE – Chemical Filter Simulation

5. Check and verify system parameters (i.e. holes pressure/flowrate, smoke transport time, etc.). If any parameter is not met, the VESDA system must be modified i.e. increase fan speed, reduce coverage, upgrade to a detector with stronger fan capacity.

Accounting for smoke transmission loss in ASPIRE:

The chemical filter causes a 20% reduction in the concentration of passing smoke. To compensate for this reduction, a 20% adjustment must be applied to the all detector alarm thresholds. For example, if initial Fire Threshold is 0.2%Obs/m, this will be adjusted to 0.16%Obs/m (0.2%Obs/m – 20%).

**Note!**

- Where more than one chemical filters are installed on the same pipe, their respective effects will be cumulative.
- The assessment relates to unused and specific chemical beads and does not account for soiling or other types of chemical beads.

3 Chemical Filter Installation

- Chemical filter must be installed in a vertical orientation close to the detector
- Each sampling pipe must have a dedicated chemical filter.
- In dusty/dirty environments install a particulate filter upstream the chemical filter. Refer to *Xtralis In-line Filter Application Note (No. 17785)*.
- Where gas detection is required, install VESDA Sensepoint XCL upstream the chemical filter. Refer to *VESDA Sensepoint XCL Large Bore Installation Manual (No. 35563)*.
- Where water is expected inside the pipe install a water trap upstream the chemical filter. Refer to *Xtralis Removal of Water Condensate Application Note (No. 17405)*.

4 Chemical Filter Commissioning and Maintenance

After installation of the chemical filter or replacement of chemical media, smoke tests must be conducted to verify system performance (smoke detection, smoke transport time) – refer to *VESDA Commissioning Guide (No. 10195)*. Particularly after installation, smoke tests must be conducted monthly until the next scheduled chemical media replacement for smoke detection verification.

The replacement interval for chemical media should follow manufacturer's instructions. Certain chemical media manufacturers² offer laboratory analysis that help establish the life cycle of chemical media and determine replacement interval. A visual check for discoloration of the chemical media can also be used as an indicator for replacement (manufacturer instructions should be followed when adopting this approach).

**Note!**

Monitoring detector airflow should not be used as an indicator of chemical filter loading.

Ensure that chemical filters bear labels stating chemical media installation and replacement date. Record all site maintenance data as per local code and standard requirements.

5 Chemical Media Disposal

While disposed as commercial waste, guidelines set by local regulations must be followed since release of adsorbed chemicals may pose environmental issues.

Consult the manufacture's Safety Data Sheets (SDS) for handling of unused and spent chemical media.

6 Further Support

Contact an Xtralis office or distributor for further information.

² For example, Purafil (<http://www.purafil.com>)

Disclaimer On The Provision Of General System Design Recommendations

Any recommendation on system design provided by Xtralis is an indication only of what is considered to be the most suitable solution to meet the needs of the common application environments described.

In some cases the recommendations on system design provided may not suit the unique set of conditions experienced in a particular application environment. Xtralis has made no inquiry nor undertaken any due diligence that any of the recommendations supplied will meet any particular application. Xtralis makes no warranty as to the suitability or performance of any recommendation on system design. Xtralis has not assessed the recommendation on system design for compliance with any codes or standards that may apply nor have any tests been conducted to assess the appropriateness of any recommendations on system design. Any person or organization accessing or using a recommendation on system design should, at its own cost and expense, ensure that the recommendation on system design complies in all respects with the provision of all legislation, acts of government, regulations, rules and by-laws for the time being in force and all orders or directions which may be made or given by any statutory or any other competent authority in respect of or affecting the recommendation on system design in any jurisdiction in which it may be implemented.

Xtralis products must only be installed, configured and used strictly in accordance with the General Terms and Conditions, User Manual and product documents available from Xtralis. Xtralis accepts no liability for the performance of the recommendation on system design or for any products utilized in the implementation of the recommendation on system design, aside from the General Terms and Conditions, User Manual and product documents.

No statement of fact, drawing or representation made by Xtralis either in this document or orally in relation to this recommendation on system design is to be construed as a representation, undertaking or warranty.

To the extent permitted by law, Xtralis excludes liability for all indirect and consequential damages however arising. For the purposes of this clause, 'consequential damage' shall include, but not be limited to, loss of profit or goodwill or similar financial loss or any payment made or due to any third party.

Recommendations on system design are provided exclusively to assist in design of systems using Xtralis products. No portion of this recommendation on system design can be reproduced without the prior approval in writing of Xtralis. Copyright and any associated intellectual property in any such recommendations on system design or documentation remains the property of Xtralis.